


Initial Sampling Springwood Elementary

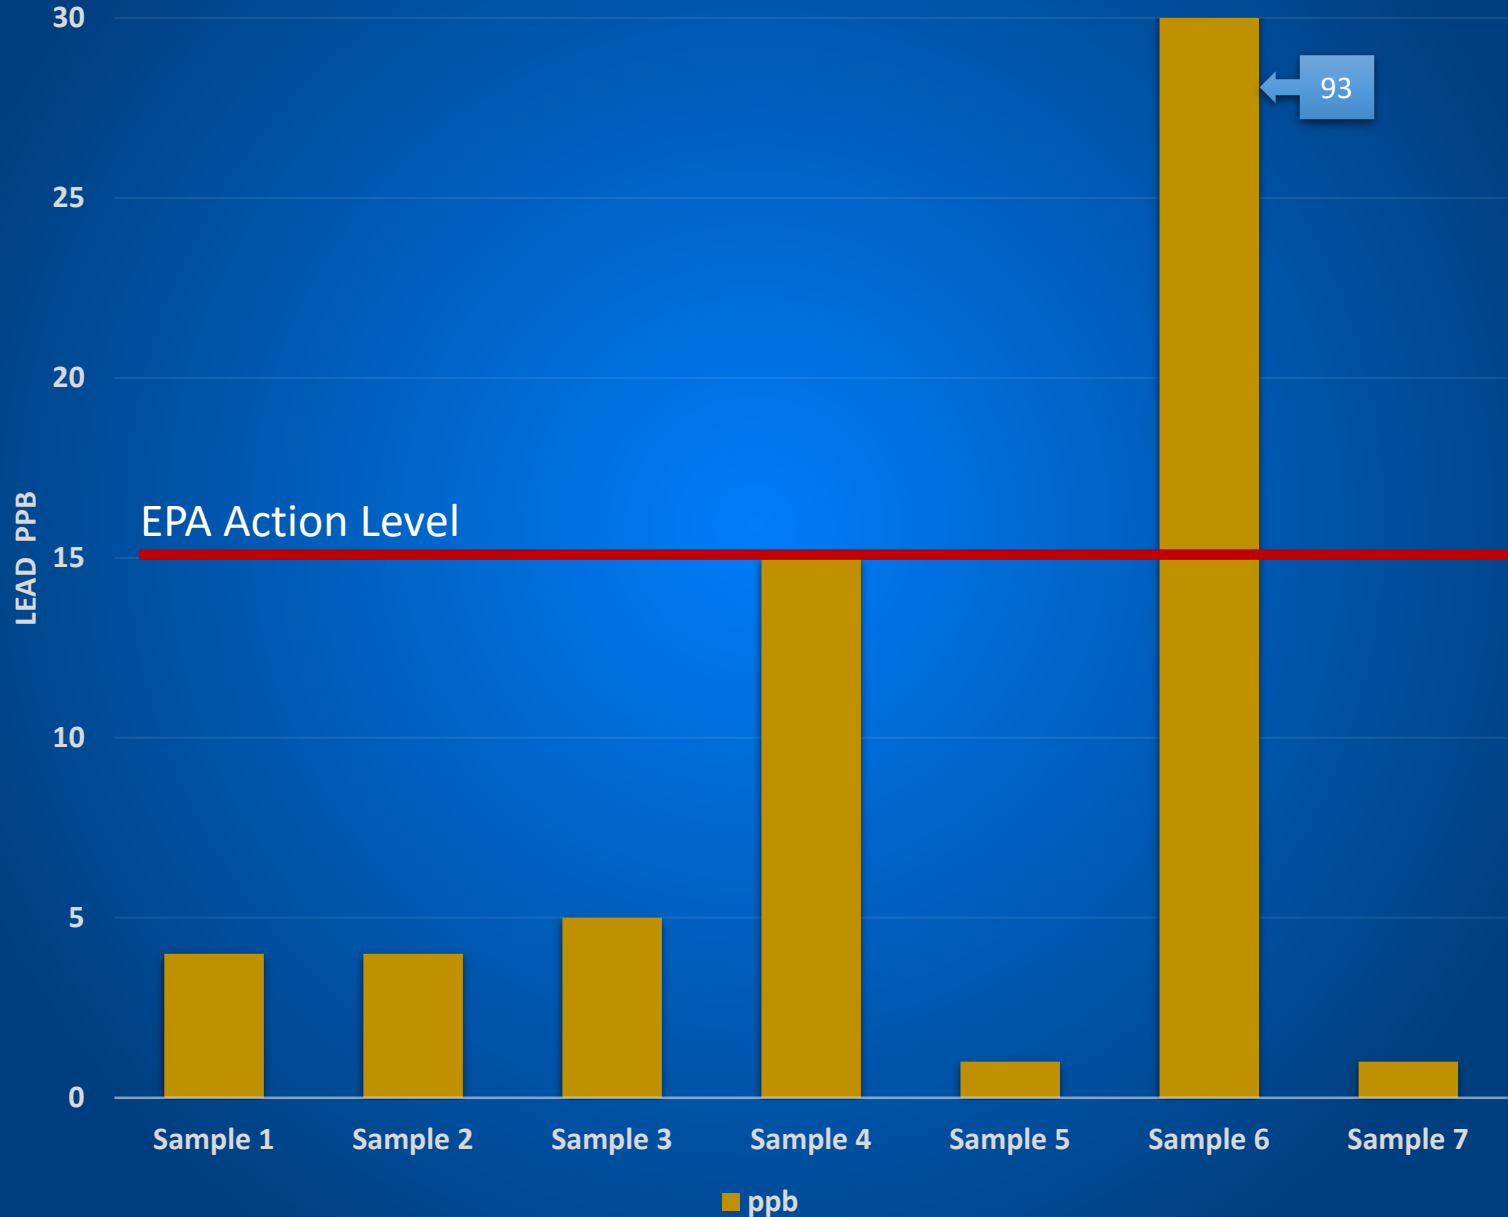


Sample	(ppb)
Sample 1	4
Sample 2	4
Sample 3	5
Sample 4	15
Sample 5	1
Sample 6	93
Sample 7	1

* Analyte not detected, reported as 1 ppb

Second Sampling

Springwood Elementary Post Corrective Actions

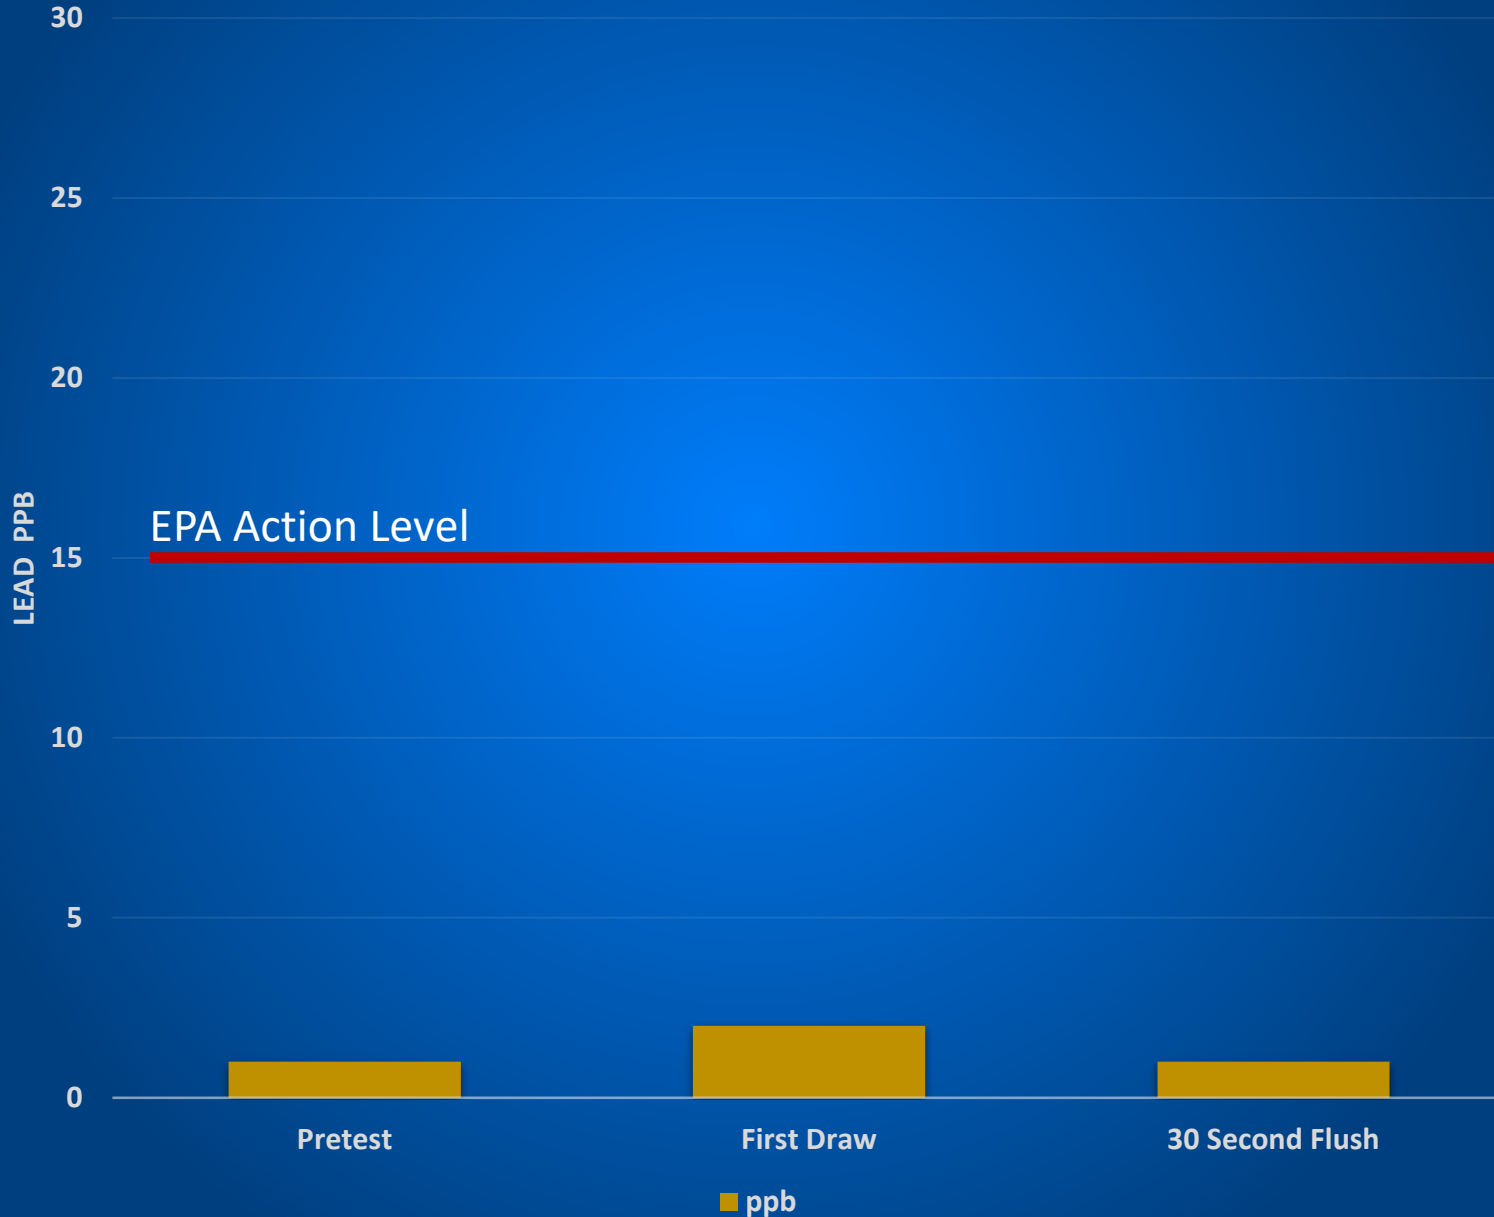

Sample	(ppb)
Pretest*	1*
First Draw	2
30 Second Flush	1

* Analyte less than 1 ppb, reported as 1 ppb